

DESIGN AND OPERATING PARAMETERS OF A FLUIDIZED BED FOR THE
COMBUSTION OF MUNICIPAL SOLID WASTE USING STANDPIPES AIR
DISTRIBUTORS

ANWAR BIN JOHARI

A thesis submitted in fulfilment of the
requirements for the award of the degree of
Doctor of Philosophy (Chemical Engineering)

Faculty of Chemical and Natural Resources Engineering
Universiti Teknologi Malaysia

MAY 2009

ABSTRACT

Hydrodynamic studies and combustion of simulated and actual municipal solid waste were carried out in a fluidized bed system. A wide range of parameters was investigated in hydrodynamic study after which the optimum parameters were implemented in the combustion studies. A newly fabricated standpipes air distributor (primary air inlet) was designed based on findings of the optimum orifice diameter, orifice distance and distance between pipes. Orifice diameter, orifice distance and distance between pipes of 3 mm, 10 mm and 70 mm were used in the hydrodynamic studies of circular and rectangular columns (CHS and RHS). The operating parameters investigated in the CHS and RHS included the effect of sand sizes and aspect ratios on the fluidization profile. Standpipes air distributors having the same orifice diameter and distance but with a wider pipe distance of 200 mm were used in the hydrodynamic studies of a bigger rectangular (big scale) column. Different air flow strategies were implemented to ensure good mixing between sand and samples and to investigate the penetration of the incombustibles into the sand bed. Parameters studied in the combustion of municipal solid waste included the effect of fluidizing velocity and air factor on the combustion profile in the bed as well as the freeboard region with standpipe air distributor design and dimension established from the hydrodynamic studies of a bigger scale rectangular column. Findings from the CHS and RHS showed that sand particles with mean size of 0.34 mm performed good fluidization profile compared to other coarser sand sizes. The ratio of the bed height over diameter of column (D_c) for good fluidization was determined at $H = D_c$ for the circular column whereas the ratio of the bed height (H) over the length (L) of column was observed at $H < L$ for the rectangular columns. A two side air flow was seen as the best air flow strategy for good mixing in a bigger rectangular column. The range of fluidization number and air factor for the combustion of simulated municipal solid waste in a rectangular fluidized bed combustor was $5 - 7 U_{mf}$ in which $5 U_{mf}$ was found to be the optimum with air factor of 0.8 (primary air). Air factor of 0.4 (secondary air) was observed to show good temperature profile in the freeboard region for the combustion of municipal solid waste. The optimum total combined air factor for the combustion of municipal solid waste was 1.2 in which inlet primary air factor and inlet secondary air factor were 0.8 and 0.4, respectively.

ABSTRAK

Kajian hidrodinamik dan pembakaran sisa pepejal perbandaran simulasi buatan dan sisa pepejal perbandaran sebenar telah dijalankan di dalam sistem turus terbendalir. Pelbagai parameter telah dikaji dalam kajian hidrodinamik yang mana keputusan yang diperolehi digunapakai di dalam kajian pembakaran di dalam turus terbendalir. Penyalur udara (penyalur udara utama) direka berdasarkan kepada keputusan optimum yang didapati setelah menjalankan kajian berkenaan diameter orifis, jarak antara orifis dan jarak antara paip. Diameter orifis, jarak antara orifis dan jarak antara paip yang digunakan di dalam kajian hidrodinamik turus terbendalir bulat dan segiempat (CHS dan RHS) adalah 3 mm, 10 mm dan 70 mm. Parameter operasi yang dikaji dalam kajian hidrodinamik CHS dan RHS bagi turus terbendalir bulat dan segiempat adalah kesan saiz pasir dan nisbah aspek ke atas profil terbendaliran. Penyalur udara yang mempunyai diameter orifis dan jarak antara orifis yang sama digunakan dalam kajian hidrodinamik turus terbendalir segiempat yang lebih besar tetapi jarak antara paip dibesarkan kepada 200 mm untuk mengkaji profil terbendaliran. Pelbagai strategi masukan udara digunakan untuk mengkaji profil terbendaliran di dalam turus terbendalir ini. Parameter yang dikaji di dalam kajian pembakaran termasuklah kesan nombor halaju udara dan pekali udara ke atas profil terbendaliran di dalam turus terbendalir. Hasil dari kajian hidrodinamik menggunakan turus terbendalir bulat dan segiempat (CHS dan RHS) menunjukkan bahawa purata saiz pasir 0.34 mm memberikan profil terbendaliran yang baik berbanding dengan saiz pasir lain. Nisbah yang optimum bagi ketinggian (H) pasir di dalam turus terbendalir kepada diameter turus terbendalir (D_c) adalah $H = D_c$ untuk turus berbentuk bulat. Manakala nisbah yang optimum bagi ketinggian (H) bendalir di dalam turus terbendalir kepada panjang (L) turus terbendalir adalah $H < L$ bagi turus berbentuk segiempat. Keputusan kajian menunjukkan julat nombor halaju udara bagi pembakaran simulasi buatan sisa pepejal perbandaran adalah $5 - 7 U_{mf}$ di mana nombor halaju udara 5 adalah yang paling optimum dengan nilai pekali udara 0.8 (pekali udara prima). Pekali udara yang menunjukkan kesan yang baik bagi pembakaran di atas pasir adalah 0.4 (pekali udara sekunder). Pekali udara keseluruhan yang optimum bagi pembakaran sisa pepejal perbandaran adalah 1.2 di mana pekali udara prima adalah 0.8 dan pekali udara sekunder adalah 0.4.

TABLE OF CONTENTS

CHAPTER	TITLE	PAGE
	TITLE PAGE	i
	DECLARATION	ii
	DEDICATION	iii
	ACKNOWLEDGEMENT	iv
	ABSTRACT	v
	ABSTRAK	vi
	TABLE OF CONTENTS	vii
	LIST OF TABLES	xiii
	LIST OF FIGURES	xvi
	LIST OF SYMBOLS	xviii
	APPENDICES	xxiii
1	INTRODUCTION	1
	1.1 Introduction	1
	1.2 Research Background	1
	1.2.1 Selection of Fuel for Combustor	2
	1.2.2 Selection of Thermal Treatment Methods	8
	1.2.3 Selection of Combustion Technology	9
	1.3 Justification of the Research	13
	1.4 Objectives of the Research	16
	1.5 Scope of the Study	17
	1.6 Thesis layout	18

2	LITERATURE REVIEW	19
2.1	Introduction	19
2.2	Fluidization Concept	19
2.3	Physical Properties of Particles	23
2.3.1	Bed Voidage (ε)	23
2.3.2	Particle Sphericity (ϕ)	24
2.3.3	The Geldart Classification of Particles	24
2.4	Bubble Dynamics	26
2.4.1	Bubble Rising Velocity and Bubble Size	27
2.5	Entrainment and Elutriation	29
2.6	Fluidized Bed Air Distributors	33
2.6.1	Current Research Work on the Standpipes Air Distributors	35
2.7	Combustion Theory	36
2.7.1	Moisture Evaporation	37
2.7.2	De-volatilization/pyrolysis	37
2.7.3	Char Combustion	41
2.8	Combustion Technology of Municipal Solid Waste	42
2.9	Combustion of Solid Waste in a Fluidized Bed	44
2.9.1	Combustion of Biomass in a Fluidized Bed	47
2.9.2	Combustion of Coal in a Fluidized Bed	49
2.9.3	Combustion of Refuse Derived Fuel (RDF) in a Fluidized Bed	50
2.9.4	Combustion of High Moisture Content Waste in a Fluidized Bed	52
2.9.5	Current Combustion Research Work	54

3	METHODOLOGY	56
3.1	Introduction	56
3.2	Scope of Research Activities	56
3.3	Formulation of the Simulated Municipal Solid Wastes and its Chemical and Physical Characterization	58
3.3.1	Analytical Tests	58
3.4	Measurement of the Physical Properties of Sand	61
3.5	Geometrical Design of a Standpipe Air Distributor	61
3.5.1	Single Orifice Study	63
3.5.2	Orifice Distance Study	64
3.5.3	Pipe Distance Study	65
3.6	Hydrodynamic of Circular and Rectangular Columns (Small Scale)	66
3.6.1	Circular Hydrodynamic Studies (CHS)	68
3.6.2	Rectangular Hydrodynamic Studies (RHS)	75
3.6.3	Combustor Selection Procedures	76
3.7	Hydrodynamics of Bigger Scale Rectangular Column	77
3.7.1	Equal Flow Studies	80
3.7.2	Centre High Studies (CH)	81
3.7.3	Two-Side High Studies (TSH)	81
3.7.4	One-Side High Studies (OSH)	82
3.7.5	Sample Preparation	83
3.8	Calorific Value of Solid Waste	83
3.9	Combustion of Simulated Municipal Solid Waste in a Rectangular Column	85
3.9.1	Sample Preparation and Experimental Set-up	88
3.9.2	Temperature, Emission Measurement and Data Logging System	90
3.9.3	Combustion Calculation for the Simulated Municipal Solid Waste Combustion Studies	95
3.9.4	Calculation of Adiabatic Flame Temperature	97
3.9.5	Thermal Efficiency	99

3.9.6	Study on Effect of Fluidization Numbers on the Combustion of Simulated Municipal Solid Waste	102
3.9.7	Study on Effect of Air Factor (AF)	106
3.9.8	Bed Pre-heating	108
3.10	Combustion of Municipal Solid Waste in a Rectangular Column	110
3.10.1	Study on the Effect of Different Fluidization Numbers (Primary Air) on the Sustainability of the Combustion of Municipal Solid Waste	113
3.10.2	Calculation of Combustion Quality and Carbon Utilization Efficiency	115
3.10.3	Study on the Effect of Secondary Air on the Combustion of Municipal Solid Waste	117
3.11	Combustion of Municipal Solid Waste in a Circular Fluidized Bed	118
3.11.1	Experimental Set-up	120
4	RESULTS AND DISCUSSION	123
4.1	Introduction	123
4.2	Effect of Sand Physical Properties on the Minimum Fluidization Velocity	124
4.3	Effect of Air Distributor Geometrical Design on the Fluidization Behaviour	126
4.3.1	Effect of Orifice Diameter	126
4.3.2	Effect of Orifice Distance	129
4.3.3	Effect of Pipe Distance	131
4.4	Summary – Geometrical Design of Standpipes Air Distributor	132
4.5	Hydrodynamic Studies of Circular and Rectangular Columns (Small Scale)	133
4.5.1	Effect of Sand Sizes on Fluidization Behaviour	133
4.5.2	Effect of Aspect Ratio on Fluidization Behaviour	140

4.6	Hydrodynamics of Bigger Scale Rectangular Column	149
4.6.1	Effect of Equal Air Flow (EF) Strategy	150
4.6.2	Effect of Centre High Air Flow (CH) Strategy	153
4.6.3	Effect of One Side High Air Flow (OSH) Strategy	156
4.6.4	Effect of Two Side High Air Flow (TSH) Strategy	158
4.7	Summary – Hydrodynamic Studies	161
4.8	Combustion Studies in a Fluidized Bed	165
4.8.1	Properties of Simulated Municipal Solid Waste	165
4.9	Combustion Study of Simulated Municipal Solid Waste	167
4.9.1	Effect of Fluidization Number on the Combustion of the Simulated Municipal Solid Waste	168
4.9.2	Adiabatic Flame Temperature and Thermal Efficiency of Simulated Municipal Solid Waste	173
4.9.3	Effect of Air Factor on the Combustion of Simulated Municipal Solid Waste	177
4.9.4	Overall Thermal Efficiency at Different Air Factors	180
4.9.5	Optimum Throughput Rate of Simulated Municipal Solid Waste Rectangular Fluidized Bed Combustor	182
4.10	Combustion Study Using Municipal Solid Waste	183
4.10.1	Effect of Fluidization Number on the Combustion of the Municipal Solid Waste	184
4.10.2	Overall Thermal Efficiency η_{TH} and Carbon Utilization Efficiency η_{CU} of Municipal Solid Waste Combustion	188
4.10.3	Gases Emission in the Combustion of Municipal Solid Waste at $5 U_{mf}$ and $AF = 0.8$	190
4.10.4	Effect of Secondary Air on the Combustion of Municipal Solid Waste	194
4.10.5	Gas Emission Yield at Different Total Air Factors	199

CHAPTER 1

INTRODUCTION

1.1 Introduction

This chapter discusses the thermal treatment of the municipal solid waste in a fluidized bed combustor. It also discusses the background of the research activities, selection and justification for the proposed study. Brief description on the reason for the utilization of fluidized bed for waste incineration is included and focus is given on the Malaysian energy scenario. The objectives of the research and the scope of work are also pointed out.

1.2 Research Background

Literatures on the utilization of the most suitable combustion technology for reduction of wastes (biomass, coal and municipal solid waste) are reviewed. It gives information and basic guidelines for the overall current research activities. This includes the selection of type of fuel to be used, thermal treatment method, combustion technology and design of air distributor.

1.2.1 Selection of Fuel for Combustor

Fuel for combustor may vary as it depends on the purpose of the burning itself. In the case of municipal solid waste, the waste itself is regarded as a fuel. Ruth (1998) has given a thorough review on the combustion technology using municipal solid waste as its feed. Another source of fuel is the biomass waste and becomes one of the promising sources of fuels for energy generation. Experimental investigation on the combustion of biomass in a pilot scale fluidized bed has been carried out by Saenger *et al.* (2001) and Natarajan *et al.* (1997) on the combustion of coffee husk and Armesto *et al.* (2002) on the combustion and gasification of rice husks. These two sources of fuels are readily available and many research and commercial activities have been done especially on the aspect of energy conservation via the integrated power plant operation system. Coal as a fuel has been another source of energy generation as commonly practised decades ago. Extensive research activities on the combustion of coal are still being carried out. Saxena *et al.* (1997) used a fluidized bed of 0.154 m in diameter and an overall height of 3.5 m on their research on the combustion of coal.

Looking into Malaysian perspective, municipal solid wastes are abundant and cause a challenging effort for the authorities to dispose it off. As a matter of fact, the increase in municipal solid waste is an indication of the progress of Malaysia towards developed nation. Solid waste generation in major urban area in peninsular Malaysia is shown in Figure 1.1.

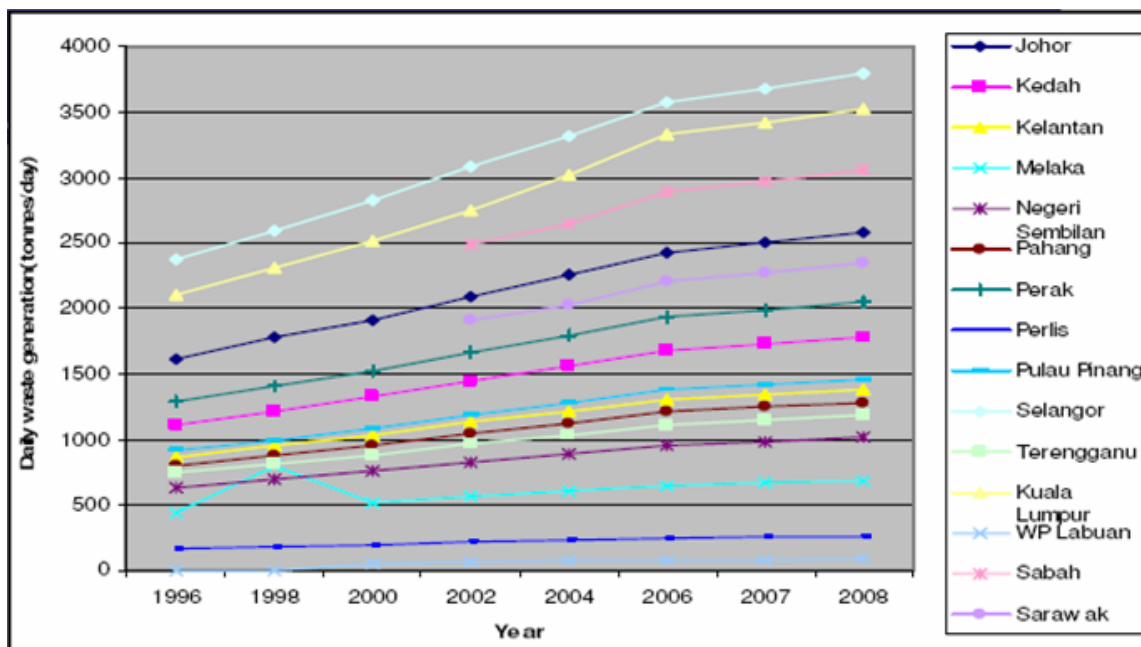


Figure 1.1: Solid waste generation in states in Malaysia (Agamuthu, 2008)

Data clearly show an increment in waste generation in states in Malaysia, so does the problem of disposing it. Currently the most widely used method of waste disposal in Malaysia is land-filling. However, with tremendous increment in waste generation annually, the Malaysian government has looked into several alternatives in reducing the disposal problem such with the possible use of thermal treatment method.

On a larger picture, the cheapest and widely used method of waste disposal in the world is land-filling. However, with a steady increase of municipal solid waste generation annually due to human activities and population growth, alternative method of solid waste disposal system is in need. Thus, combustion or gasification of municipal solid waste comes into the picture. Of the three sources of fuels stated above (municipal solid waste, biomass and coal), municipal solid wastes are heterogeneous in nature, therefore, investigating the combustion of municipal solid waste in the laboratory scale fluidized bed is very difficult. Municipal solid waste has been successfully burnt in a grate combustion system or mass burn combustion system (Ruth, 1998). On the other hand, refuse derived fuel (RDF) which is fuel originated from municipal solid waste after segregation and separation of municipal

solid waste components has been used in a fluidized bed combustor (Piao *et al.*, 2000; Hernandez-Atonal *et al.*, 2007).

The compositions of the municipal solid waste vary with geographical location, social and economic status. For example, the amount of moisture in municipal solid waste is low in industrialised countries, whereas wastes in developing countries especially in ASEAN region contain high moisture content. Typical distribution of components in municipal solid waste for Thailand and the United Kingdom is shown in Table 1.1.

Table 1.1: Waste components of municipal solid waste for Thailand and the UK (Patumsawad and Cliffe, 2002)

Component	Thailand	United Kingdom
Paper	13%	31%
Food waste	39%	25%
Plastics	10%	8%
Textile, rubber, leather and wood	23%	5%
Metal		8%
Glass	15%	10%
Other		13%

Karthirvale *et al.* (2003) conducted municipal solid waste characterization on the medium income residential areas in Kuala Lumpur in 2001. Table 1.2 shows the summary of the waste composition from the medium income residential areas generated in Kuala Lumpur.

Table 1.2: Compositions of municipal solid waste generated from residential medium income in Kuala Lumpur (Karthirvale *et al.*, 2003)

Component	Weight percent (%)
Food/organic	38.42
Mix paper	7.22
Newsprint	7.76
High grade paper	1.02
Corrugated paper	1.75
Plastic (rigid)	3.57
Plastic (film)	14.75
Plastic (foam)	1.72
Diapers	7.58
Textile	3.55
Rubber/leather	1.78
Wood	1.39
Yard	1.12
Glass (clear)	2.07
Glass (coloured)	2.02
Ferrous	3.05
Non-ferrous	0.00
Aluminium	0.08
Batteries/hazardous material	0.18
Fine	0.71
Other organic	0.00
Other inorganic	0.27
Others	-
TOTAL	100

With regards to the varying composition of wastes in the municipal solid wastes, efforts have been made to simulate the municipal solid wastes compositions according to its major compositions. This is the first step towards understanding the burning behaviour of the actual municipal solid wastes. The operating parameters of

the fluidized bed combustion of municipal solid waste will be based on findings from the combustion of the simulated municipal solid waste. The formulation of the simulated municipal solid waste used in the current research activities is based on the data gathered from the municipal solid waste characteristics study conducted in Kuala Lumpur (Rozainee, 2001). The simulated municipal solid waste is made of four major categories; namely, food waste, plastics, paper and vegetable wastes. Proximate analysis was conducted to investigate the simulated municipal solid waste compositions in terms of four constituents; namely moisture content, volatile matter, ash and fixed carbon. Ultimate analysis was carried out to determine the chemical elements that make up the sample namely carbon content, hydrogen content and oxygen content. The percentage compositions of these waste categories are shown in Table 1.3. Appendix A shows the detail calculation and formulation of simulated municipal solid wastes.

Table 1.3: Compositions of simulated municipal solid waste

Simulated municipal solid waste	Percentage (%)
Rice waste	27
Shredded paper	19
Plastic film (LDPE)	25
Vegetable waste	29

Other researchers have conducted various experiments with simulated waste but the samples were not representative to the Malaysian scenario. Patumsawad and Cliffe (2002) used pre-dried chicken manure pellets. Water was added to generate the required percentage of moisture content as their objective was to demonstrate the technical feasibility of a fluidized bed for burning high moisture municipal solid waste. Thipse *et al.* (2002) investigated the chemical and physical characteristics of a synthetic fuel to represent the collective composition of municipal solid waste in the United States. The majority of fuel consists of paper and wood whilst low density polyethylene was chosen to represent the plastic polymer and iron represented the metal content. Animal feed and water simulated the waste food organic contents and the inert component silica made-up the rest of the fuel. The fuel is made in three

stages: (i) mixing the components, (ii) size reduction by shredding, (iii) compaction into cylindrical pellets of 2.5 cm diameter and approximated length of 5 cm.

Yang *et al.* (2003) presented another technique for the formulation of the simulated municipal solid waste. The major fuel in the simulated waste consists of cardboard and vegetable and the weight ratio between the cardboard and vegetable was 1.85:1 which is in accordance to the ratio between paper and food content in a typical United Kingdom municipal solid waste. Knowing the waste characteristics enable researchers to simulate the feed into the combustor. The majority of the combustible materials in the municipal solid waste derived from paper and plastics. These materials if it were to be separated or sorted out from the bulk of the municipal waste could be used as a potential fuel for the combustor as they yield high calorific values. Salvador *et al.* (2004) studied the combustion of substitution fuels that were made from compressed mixes of cardboard and polyethylene. These two materials represent the two classical classes of waste components.

Municipal solid waste disposal has always been seen as a burden but with good solid waste management, the municipal solid waste is actually an asset. Having known the waste compositions in the municipal solid waste enables the separation of combustible and incombustibles prior to the combustion of the wastes. The municipal solid waste could be turned into resources of energy and electricity generation through the implementation of the state of the art thermal decomposition method such as demonstrated by the fluidized bed combustion or gasification system.

One advantage of thermal conversion of municipal solid waste is the energy recovered from its combustion. In order to evaluate the feasibility of energy recovery in the combustion plant, it is of a great importance to determine the energy content or calorific value of the solid waste. Calorific values and water content in municipal solid waste play an important role as higher calorific value significantly determines the quality of the combustion in terms of heat released. Water content influences the combustion behaviour in terms of its temperature profile and volume of gas produced. Because municipal solid waste is a heterogeneous material and production rate and physical composition vary from place to place as they are a function of socio-economic level climatic conditions, the energy content of municipal solid

waste in one country will be different from that of another. Table 1.4 shows the heat content of municipal solid waste in Thailand and United Kingdom.

Table 1.4: Heat content of municipal solid waste

High Heating Value (HHV)	MJ/kg (as received)	MJ/kg (dry basis)
Thailand	6.49 MJ/kg*	15.59 MJ/kg*
United Kingdom	10.25 MJ/kg*	15.0 MJ/kg*

* Data from Patumsawad and Cliffe, (2002).

Knowledge of the physical characteristics and chemical composition of municipal solid waste are crucial as these parameters influence the overall behaviour of the combustion system. For example, differences in properties of coal and municipal result in differences in the combustion characteristics of these fuels and in turn affect the type of combustion equipment. In particular, the most important fuel properties are the size of the fuel particles and the fuel composition. The size of fuel particle affects the length of time required for its combustion. Municipal solid waste for example comprises of extremely variable sizes and shapes, thus longer residence times are required to completely burn the waste.

1.2.2 Selection of Thermal Treatment Methods

Various methods of waste decomposition have been employed due to several reasons depending on the end product requirement, such as pyrolysis, combustion or gasification techniques. Pyrolysis for instance, is the decomposition of waste with heat alone in the absence of air. It has been used to decompose biomass waste such as straw and stalk of rapeseed plants (Karaosmanoglu *et al.*, 1999) and wood, coconut shell and straw (Fagbemi *et al.*, 2001). Pyrolysis of the biomass has gained increasing attention since the process conditions can be optimised to produce high energy density liquid (tar) products in addition to the derived char (solid) and gas.

Normally pyrolysis reaction temperature is carefully controlled at around 500⁰C. Much of the present interest in pyrolysis is focused on the liquid (tar) production. However, as pyrolysis liquid contains organic materials and water, many are reported to contain polycyclic aromatic hydrocarbon (PAH), some of which have shown to be carcinogenic. Horne and Williams (1996) reported that the pyrolysis liquid of mixed wood contains both monocyclic hydrocarbon such as benzene, toluene and dimethyl and ethylbenzene and polycyclic aromatic hydrocarbons. On the shorter note, by assessing the pros and cons of pyrolysis technique, the idea of using this method into the present research activities is unrealistic since pyrolysis technique is not intended for the mass reduction of solid waste. Hence, other techniques such as combustion or gasification will be the best bet for solving the problems of municipal solid waste disposal.

Combustion and gasification technology are two thermo-chemical treatments that have gained much interest in recent years. These processes offer a more realistic approach in dealing with the tremendous increase in the municipal solid waste in Malaysia. In a gasification process, waste is converted to a combustible gas mixture by partial oxidation (starved air condition) of waste at high temperature, typically in the range of 800 – 900⁰C. The main gaseous components are carbon monoxide and hydrogen. Combustion process on the other hand requires excess air, thus producing carbon dioxide and water. These two processes carried out in a fluidized bed combustor offer upstream flexibility (biomass, coal and municipal solid waste) and downstream product flexibility (gaseous products) advantages.

1.2.3 Selection of Combustion Technology

The combustor is the heart of the combustion or gasification process. It is where the combustion of fuels (biomass, coal, municipal solid waste) takes place. Various combustion technologies have been employed and operated successfully. Combustors for biomass and municipal solid waste are predominantly either grate-fired system or fluidized bed. Biomass is generally fed into the fluidized bed. Past practices showed that municipal solid waste is normally incinerated in a grate-firing

system, whereas refused derived fuel (RDF) is commonly burnt in a fluidized bed. Grate-firing systems are equipped with flat or sloping grates. The grates may either be moving or stationary in design. The moving grate system requires large operational area and not economical to be constructed just for the academic exercises. On the other hand, the stationary grate system is a fixed bed combustion system and even though requires less operational area and economical, the combustion behaviour of a fixed bed and fluidized bed is different. Both grates system do not have a fluidization medium, thus, not within the scope and objectives of the current research study. Grate-firing reactors were the most versatile units in the mid 1980s.

Fluidized beds have only gained tremendous acceptance in the recent years due to several reasons. One of them is the ability to burn various types of fuels because it provides long fuel residence times, good contacting of fuel and bed material with air with a relatively uniform temperature distribution inside the bed. In the fluidized bed system, the bed is first heated close to the operating temperature. The bed material, usually sand, absorbs and stores the heat, while the turbulence and mixing of the bed keeps the temperature uniform throughout the bed. When waste is introduced into the fluidized bed, the high heat and mass transfer characteristics of the bed permits the rapid energy conversion at practically isothermal condition. The high surface area available in fluidized beds on which reactions could occur, result in good conversion efficiency, higher throughput and lower operating temperature. Uniform temperatures and high heating capacities of sand permits a wide range of low-grade fuels of even non-uniform size and varying moisture content to be converted to desired products (Natarajan *et al.*, 1997).

Two types of fluidized beds are bubbling fluidized bed (BFB) and circulating fluidized bed (CFB). In the bubbling fluidized bed (BFB) combustor, the majority of fuel particles which are fed onto the bed react in the bed with the oxygen in the upward airflow (primary air). Therefore, the lower combustion zone contains a high density of the fuel and during the combustion, the bed acts as a heat buffer enabling high heat transfer between the particles. Due to this, the BFB could tolerate larger fuel size (0 – 50 mm) than the CFB combustor and the BFB combustor is also less sensitive to variations in the fuel moisture content and it is suitable for waste with

wide variation of moisture contents. The mass concentration of fine particles is less in the BFB compared to that of the CFB due to the lower application of the fluidization number in the BFB. The BFB combustor operates at lower fluidization velocity, typically 1-3 m/s whereas the CFB combustor operates at higher fluidization velocity ranges from 3 – 10 m/s (Koornneef *et al.*, 2007). As a result of the higher fluidization velocity in the CFB combustor, solids are entrained in the air flow more equally along the combustor height and the heat transfer and combustion temperature is more equally distributed with the combustor height compared to the BFB. With an increase in the mass load of the elutriated fine particles, the design of the cyclone separator would be larger in the CFB than in the BFB. Thus, increasing the investment cost of the CFB system (Anthony, 1995). In the CFB combustor, the major portions of the dust and unconverted carbon in the product gas are recycled to the reactor bottom through a cyclone, thus leading to high carbon conversion.

The BFB combustor offers the best solution as it gives good distribution of temperature inside the entire bed and freeboard. The heat exchange between the waste, sand and gases is very good due to their intimate mixing at high temperature. With larger fuel size acceptability and moisture content variations in the municipal solid waste, the BFB is considered the best choice despite the drawback in the temperature distribution along the bed height which is not as good as in the CFB. In the CFB combustor, the operation is carried out at higher velocity compared to the BFB combustor. Hence, it increases the pumping power of the fluidization air into the combustor which significantly increases the operating cost. Furthermore, additional costs of capital and operating costs have to be invested due to the construction of a ‘return leg’ at the bottom of the cyclone to enable the unconverted carbon from the cyclone to re-enter into the combustor. The difference in the operation and design of the BFB and CFB results in the variation of investment costs. The investment costs of the BFB and CFB systems less than 10 MW_e in several biomass-to-energy plants in Finland is presented in Table 1.5. The plants operate on the power-to-heat ratios of about 0.35 (Bain *et al.*, 1998).

Table 1.5: Investment cost of small cogeneration plants in Finland (Bain *et al.*, 1998)

Plant	Capacity power/heat (MW _e /MW _t)	Type of combustor	Investment cost (£ Million)
Pieks-m-ki	9/25	BFB	9.5
Kankaanp	6/16	BFB	8.0
Kuhmo	5/13	CFB	12.3
Ylivieska	5/15	BFB	8.7
Kuusamo	6/17	BFB	8.0
Lieksa	8/22	CFB	11.3

The schematic diagram of the bubbling and circulating fluidized bed combustors is shown in Figure 1.2.

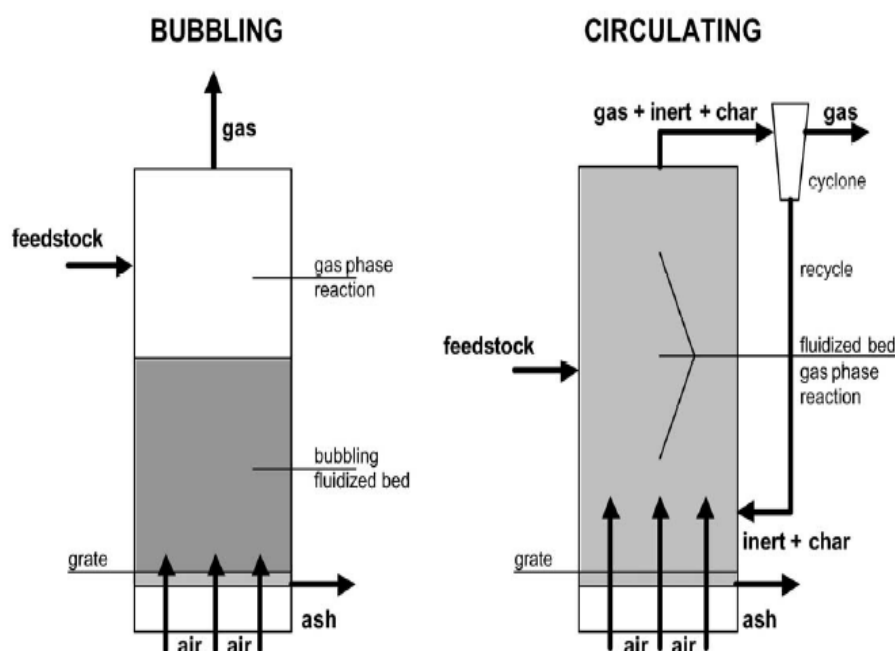


Figure 1.2: Schematic of Bubbling and Circulating Fluidized Bed Combustors (Belgiorno *et al.*, 2003)

Considering the existing laboratory facilities and from the evaluation of operation, design and costs of the BFB and CFB, the BFB combustor system is chosen for the current research work.

1.3 Justification of the Research

The title of the research is '**Design and Operating Parameters of a Fluidized Bed for the Combustion of the Municipal Solid Waste using Standpipes Air Distributor**'. As stated from the research title, the study focuses on the three major aspects, as listed below;

- (i) operating parameters of fluidized bed
- (ii) municipal solid waste
- (iii) standpipes air distributor design

These three elements have been pointed out as the determining factors to the successful operation of the fluidized bed system and its importance in this research study. The study of the municipal solid waste combustion is difficult to be conducted in a laboratory scale fluidized bed due to reason associated to its heterogeneous and inconsistent compositions and varying in sizes from as bulky as the office furniture to as small as an organic human hair. Furthermore, the physical characteristics of municipal solid waste such as moisture content, volatile matter content, fixed carbon content and ash content also vary depending on the individual waste component. Chemical compositions of simulated municipal solid wastes such as carbon content, oxygen content, hydrogen content also varies according to the waste itself. Hence, the municipal solid wastes characteristic, physical and chemical compositions at any given time are not constant and pose problems during the experimental investigation in a small fluidized bed laboratory scale. However, the limitation can be overcome with the use of the simulated municipal solid waste, which is formulated from the typical average waste compositions in Malaysia. The simulated municipal solid wastes comprise of four major waste components in the actual municipal solid waste namely; paper, plastic, green (vegetable waste) and food waste. Other wastes

components such as glass, rubber and metal are omitted from the formulation of simulated municipal solid wastes since their compositions are low in the actual municipal solid wastes. These four components of wastes are taken from the same source, thus, giving consistent waste characteristics in terms of its physical and chemical compositions and moisture content. Results from the combustion of the simulated municipal solid wastes are used as an input to the actual combustion of municipal solid wastes.

Physical and chemical characteristics of municipal solid waste are useful in the design of a fluidized bed combustion system. For example, information on the carbon, hydrogen and oxygen content of the municipal solid waste or simulated municipal solid waste enables the calculation of air requirement for the complete combustion, excess air combustion or even starved air combustion (gasification). Furthermore, enables of estimation of air compressor power and costing. Physical characteristic on the other hand provides information of the waste itself such as the density of the waste which gives an indication of the mixing of the waste in the fluidized bed, whether the waste float on the sand or penetrate inside the sand bed. The amount of water in the waste gives an indication of the burning profile in the sand bed. It shows the sustainability of the waste combustion inside the sand bed. Volatile matter for example gives information whether the combustion is on the freeboard (region above the surface of the sand bed) or bed combustion. Therefore, knowledge of the municipal solid waste characterization, physical and chemical compositions are crucial as data gathered are useful for the formulation of the simulated municipal solid waste, design and operation of the fluidized bed.

The design of the air distributor in which the fluidizing air flows through the bed is critical as it determines the quality of the fluidization inside the bed. Various designs have been used such as porous and perforated plates. However, the drawback of these designs is the clogging of un-burnt fuels and its inability to freely dispose off the remaining ash and other incombustibles, as one needs to dismantle the air distributor after each test. Furthermore, the mixing of low density waste with sand is poor due to the inability of the waste to penetrate inside the bed. These designs unable to cause good circulation of sand and therefore mixing of low density wastes are relatively poor. The new air distributor design has the ability to control the air

into the fluidized bed, thus, permitting the mixing of low density waste into the sand bed. The new design also has the advantage over those two conventional designs as it permits the disposal of ash and other incombustibles without even dismantling the distributors. Focus on the new design includes the geometrical design such as orifice size, orifice distance and distance between each distributor pipe and their effect on the bed hydrodynamics.

The combustor shape and size are also looked into to study their effects on the fluidization. The shape of the fluidized bed chosen for the study is of rectangular and circular columns. The effect of combustor shapes and sizes on the bubble formation would be observed as bubble plays a significant part in the mixing behaviour of waste and sand. Other aspects such as the fluidizing numbers and bed height are also investigated. The sand size (fluidizing medium) also plays an important role as their properties would influence the bed hydrodynamics. The operating parameters such as air factor (ratio of air supplied to the combustor to the stoichiometric air) and feed rate into reactor are also part of the research activities as the purpose of the fluidized bed combustion is to maximize the feed rate of fuel.

In a much larger picture, the Malaysian government has encouraged the use of new source of energy such as renewable energy to supplement the conventional oil, gas, hydro and coal. In this regard, the fuel diversification policy is extended to include renewable energy as the fifth fuel, particularly biomass waste. These include waste from palm mills, sawmills and paddy straw and rice husk. The government's policy on the renewable energy through Small Renewable Energy Programme (SREP) is seen as a major milestone in determining the success of the 'waste to energy' projects. To date three small power producers (SPP) are under construction. The SPPs are Bumibiopower, TSH Resources and Jana Landfill. Bumibiopower's renewable energy plant uses palm waste as biomass fuel and is located at Pantai Remis, Perak. The plant will have the capacity to generate 5.2 MW of electricity with the use of stoker type boiler. TSH Resources also uses palm wastes as its fuel and generates 14 MW of electricity. The plant is located in Kunak, Sabah. Jana Landfill's energy plant in Puchong, Selangor will have a generating capacity of 2 MW and will use landfill gas as fuel. The thermal method of 'waste to energy' concept using

fluidized bed system has many advantages over the conventional land-filling operation.

The fluidized bed system can be used for biomasses and municipal solid waste (in the form of refuse derived fuel), thus, with its broad feedstock flexibility, the fluidized bed operation is highly recommended for fast disposal of waste. According to Ma (1997) there are 2.4 million hectares under oil palm cultivation nationwide which produce a large amount of residual waste. The timber industries generate some 12 million tonnes of logging residues and 3 million tonnes of wood waste a year. Paddy straw and rice husk accounted to about 3 million tonnes and 434,000 tonnes per year respectively.

Various incentives have been offered by the government to promote the renewable energy power projects (Koh and Hoi, 2002). The government can endorse *Pioneer Status (PS)* with full exemption for 10 years or given a *Investment Tax Allowance (ITA)* which is beneficial for heavy up-front capital costs.

1.4 Objectives of the Research

The objectives of this research are as follows;

- (i) To design and fabricate a new air distributor for the hydrodynamics and combustion studies
- (ii) To study the bed hydrodynamics of fluidized bed under various experimental rig design
- (iii) To determine the range of operating parameters for the combustion of the simulated municipal solid waste
- (iv) To determine the operating parameters for the combustion of municipal solid waste

1.5 Scope of the Study

In order to achieve the objectives of this research, the programme of work have been divided into several sections as listed below;

- i) The initial work consisted topics related to the fundamental concepts of fluidized bed hydrodynamics, combustion theory and waste combustion in a fluidized bed.
- ii) The proximate and ultimate analyses were conducted to gives an insight into the waste physical characteristics. Methods on the formulation of the simulated waste were presented in great details. Geometrical design and the fabrication of air distributors were also presented.
- iii) Bed hydrodynamic studies were conducted using circular and rectangular columns (small rigs) to give better understanding of the fluidization concept. The studies involved the manipulation of fluidizing numbers and bed height to determine the fluidization quality. Sand physical characteristics and its effect on fluidization were also examined.
- iv) Up-scaling of the smaller rig were based on the findings from the hydrodynamics studies. The study focused on the Air Flow Strategy introduced into the fluidized bed reactor.
- v) The combustion of the simulated municipal solid wastes were conducted according to the specified choice of fluidizing numbers, bed height, sand size and air flow strategy. The ranges of operating condition were obtained through the manipulation of fluidizing numbers, feed throughput and the air factor. Temperature monitoring in the bed and freeboard region were used to explain the combustion profile.
- vi) Combustion of municipal solid waste was based on parameters obtained from the combustion of the simulated municipal solid waste

REFERENCES

- Abelha, P., Gulyurtlu, I., Boavida, D., Seabra Barros, J., Cabrita, I., Leahy, J., Kelleher, B. and Leahy, M. (2003). Combustion of poultry litter in a fluidised bed combustor, *Fuel*. 82: 687-692.
- Agamuthu, P. (2008). Solid Waste: Environmental Factors and Health. *EU – Asia Solid Waste Management Conference*. Ipoh. Malaysia.
- Amitin, A.V., Martyushin, I.G. and Gurevich, D.A. (1968). Dusting in the Space Above the Bed in Converters with a Fluidised Catalyst Bed. *Chem. Technol. Fuels Oils*. 3-4. 181.
- Anthony, E.J. (1995). Fluidized Bed Combustion of Alternative Solid Fuel; Status, Successes and Problems of the Technology. *Prog. Energy Combust. Sci.* 21: 239-268.
- Armesto, L., Bahillo, A., Veijonen, K., Cabanillas, A. and Otero, J. (2002). Combustion behaviour of rice husk in a bubbling fluidized bed, *Biomass and Bioenergy*. 23: 171-179.
- Aziz, A.A., Musa, M.N. and Salleh, M.S.M. (1995). Thermal Energy Generation using Multi-Stage Combustor for Drying of Agriculture Produces. *The 4th ASEAN Science and Technology Week Conference*. Bangkok. Thailand.
- Bain, R.L., Overend, R.P. and Craig, K.R. (1998). Biomass-fired Power Generation. *Fuel Processing Technology*. 54: 1-16.
- Bauer, W. and Werther, J. (1982). The role of gas distribution in fluidised bed chemical reactor design. *Chem. Eng. Commun.* 18: 137-147.
- Belgiorno, V., De Feo, G., Della Rocca, C. And Napoli, R.M.A. (2003). Energy from gasification of solid wastes. *Waste Management*. 23: 1-15.
- Bolton, L.W. and Davidson, J.F. (1987). Dense Phase Circulating Fluidised Beds. *Chem. Eng. Comm.* 62: 31-51.
- Broadhurst, T.E. and Becker, H.A. (1975). Onset of Fluidization and Slugging in Beds of Uniform Particles. *AIChE Journal*. 21: 238-247.

- Catipovic, N.M., Jovanovic, G.N. and Fitzgerald, T.J. (1978). Regimes of Fluidization for Large Particles. *AIChE Journal*. 2. No.3.
- Chakraborty, R.K. and Howard, J.R. (1981). Combustion of char in shallow fluidised bed combustors: influence of some design and operating parameters. *Journal of the Institute of Energy*. 48-54.
- Chem, J.S. and Hayhurst, A.H. (2006). A model for the devolatilization of a coal particle sufficiently large to be controlled by heat transfer. *Combustion and Flame*. 146: 553 – 571.
- Colakyan, M. and Levenspiel, O. (1984). Elutriation From Fluidised Beds. *Powder Technology*. 38: 223-232.
- Cranfield, R.R. and Geldart, D. (1974). Large Particle Fluidization. *Chem. Eng. Sci.* 29: 935-947.
- Darton, R.C., LaNauze, R.D., Davidson, R.F. and Harrison, D. (1977). *Transactions of the Institution of Chemical Engineers*. 55: 274-280.
- Davidson, J.F. and Harrison, D. (1963). *Fluidized Particles*. Cambridge University Press, New York.
- De Luca, L, Di Felice, R. and Foscolo, P.U. (1992). Slugging behaviour of fluidised bed of large particles. *Powder Technology*. 69: 171-175.
- Dimattia, D.G., Amyotte, P.R. and Hamdullahpur, F. (1997). Slugging Characteristics of Group D Particles in Fluidised Beds. *The Canadian Journal of Chemical Engineering*. 75.
- Ergun, S. (1952). Fluid Flow Through Packed Bed Columns. *Chemical Engineering Progress*. 48. No.2: 89-94.
- Fagbemi, L., Khezami, L. and Capart, R. (2001). Pyrolysis products from different biomasses: Application to the thermal cracking of tar. *Applied Energy*. 69: 293-306.
- Felder, R. M. and Rousseau, R. W. (2000). *Elementary Principles of Chemical Processes*. Third Edition. Wiley International Edition. 467-468.
- Feng, D., Chen, H. and Whittings, W.B. (1985). The effect of distributor design on fluidised bed hydrodynamic behaviour. *Chem. Eng. Commun.* 36: 317-332.
- Geldart, D. (1971). The Size and Frequency of Bubbles in Two and Three Dimensional Gas Fluidized Beds. *Powder Technology*. 4: 41.
- Geldart, D. (1972). The Effect of Particle Size and Size Distribution on the Behaviour of Gas-Fluidised Beds. *Powder Technology*. 6: 201-215.

- Geldart, D. (1973). Types of Gas Fluidisation. *Powder Technology*. 7: 285-292.
- Geldart, D. and Baeyens, J. (1985). The Design of Distributors for Gas-Fluidised Beds. *Powder Technology*. 42: 67-78.
- Geldart, D., Hurt, J.M. and Wadia, P.H. (1978). *Slugging in Beds of Large Particles*. AIChE Symp. Series. 176. 74.
- Geldart, G. (1973). Types of Gas Fluidization. *Powder Technology*. 7: 285-292.
- Getti, P, Robertis, U.D., D'Antone, S., Villani, M. and Chiellini, E. (1985). Coal Combustion – Correlation between surface area and thermogravimetric analysis data. *Fuel*. 64: 950-955.
- Gidaspow, D., Seo, Y.C. and Ettehadieh, B. (1983). Hydrodynamics of Fluidization: Experimental and Theoretical Bubble Sizes in a Two-Dimensional Bed With a Jet. *Chem. Eng. Commun.* 22: 253-272.
- Goh, Y.R., Siddal, R.G., Nasserzadeh, V., Zakaria, R, Swithenbank, J., Lawrence, N., Garrod, N., Jones, B. (1998). Mathematical Modelling of the burning bed of a waste incinerator. *Journal of the Institute of Energy*. 71: 110-118.
- Haider, A and Levenspiel, O. (1989). Drag Coefficient and Terminal Velocity of Spherical and Non-Spherical Particles. *Powder Technology*. 58: 63-70.
- Hamdullahpur, F. and MacKay, G.D.M. (1986). Two-Phase Flow Behaviour in the Freeboard of a Gas-Fluidized Bed. *AIChE Journal*. 32. No. 12: 2047-2055.
- Hampartsoumian, E. (1983). The influence of fuel burning characteristics on the performance of a fluidized bed combustor, *IMechE*. C77/83.
- Hernandez-Atonal, F. D., Ryu, C, Sharifi, V. N. and Swithenbank, F. (2007). Combustion of refuse derived fuel. *Chemical Engineering Science*. 62: 627 – 635.
- Horio, M. and Nonaka, A. (1987). Generalised Bubble Diameter Correlation in Gas-Solid Fluidised Beds. *AIChE Journal*. 33. No. 11.
- Horio, M., Nonaka, A., Sawa, Y. and Muchi, I. (1986). A new Similarity Rule for Fluidized Bed Scale-up. *AIChE Journal*. 32. No. 9: 1466-1482.
- Horne, P.A. and Williams, P.T. (1996). Influence of temperature on the products from the flash pyrolysis of biomass. *Fuel*. 75. No. 9: 1051-1059.
- Hsiung, T.P. and Grace, J.R. (1978). Formation of bubbles at an orifice in fluidised beds. Fluidization. *Proceedings of the Second Engineering Foundation Conference*. Cambridge University Press. 19 – 24.

- Kanury, A.M. (1994). Combustion characteristics of biomass fuels. *Combust. Sci. and Tech.* 97: 469-491.
- Karaosmanoglu, F., Tetik, E. and Gollu, E. (1999). Biofuel production using slow pyrolysis of the straw and stalk of the rapeseed plants. *Fuel Processing Technology.* 59: 1-12.
- Karthirvale, S., Muhd Noor Muhd Yunus, Kamaruzzaman Sopian and Abdul Halim Samsudin (2003). Energy Potential from Municipal Solid Waste in Malaysia. *Renewable Energy.* 29: 559-567.
- Knowlton, T.M., Karri, S.B.R. and Issangya, A. (2005). Scale-up of fluidized bed hydrodynamics. *Powder Technology.* 150: 72-77.
- Kobayashi, N., Yamazaki, R. and Mori, S. (2000). A Study on the behaviour of bubbles and solids in bubbling fluidised beds. *Powder Technology.* 113: 327-344.
- Koh, M.P. and Hoi, W.K. (2002). Renewable energy in Malaysia: a policy analysis. *Energy for Sustainable Development.* VI. No.3.
- Koornneef, J., Junginer, M, and Faaij, A. (2007). Development of fluidized bed combustion – An overview of trends, performance and cost. *Progress in Energy and Combustion Science.* 33: 19 – 55.
- Kunni, D and Levenspiel, O. (1991). *Fluidization Engineering.* 2nd Edition. Butterworth-Heinemann.
- Kunni, D., Yoshida, K. and Levenspiel, O. (1968). *Inst. Chem. Eng. Symp.* 30. 79.
- La Nauze, R. D. (1985). Fundamentals of coal combustion in fluidized beds. *Chem Eng Res Des.* 62.
- Leung, L.S. (1972). Design of Gas Distributors and Prediction of Bubble Size in Large Gas-Solid Fluidised Beds. *Powder Technology.* 6: 189-193.
- Lin, C.H., Wey, M. Y. and You, S.D. (2004). Effect of concentration of bed materials on combustion efficiency during incineration. *Energy.* 29: 125-136.
- Ma, A.N. (1997). *Proceedings of the Regional Expert Consultation on Selection Criteria and Priority Rating for Assistance to Traditional Biomass Energy Using Industries.* RWEDP Report No. 32.
- Makhorin, K.E., Pikashov, V.S. and Kuchin, G.P. (1978). *Fluidization – Proceedings of the Second Engineering Foundation Conference.* Cambridge University Press. 39.

- Mansaray, K.G. and Ghaly, A.E. (1998). Thermogravimetric Analysis of Rice Husks in an Air Atmosphere. *Energy Source*. 20: 653-663.
- Matsen, J.M. (1995). Design and scale-up of CFB catalytic reactors. *Circulating Fluidized Beds*, Chapman & Hall, London, 489-503.
- Mollerus, O. (1982). Interpretation of Geldart's Type A, B, C and D Powders by Taking Into Account Interparticle Cohesion Forces. *Powder Technology*. 33: 81-87.
- Mori, S and Wen, C.Y. (1975). Estimation of Bubble Diameter in Gaseous Fluidised Beds. *AIChE Journal*. 21. No.1: 109-115.
- Natarajan, E., Nordin, A. and Rao, A.N. (1997). Overview of Combustion and Gasification of Rice Husks in Fluidised Bed Reactors. *Biomass and Bioenergy*. 14. No. 5/6: 533-546.
- Neogi, D., Chang, C.C., Walawender, W.P. and Fan, L.T. (1986). Study of Coal Gasification in an Experimental Fluidized Bed Reactor. *AIChE Journal*. 32: No. 1. 17 – 28.
- Ngo, S.P. (2007). *Production of amorphous silica from rice husk in fluidized bed system*. Universiti Teknologi Malaysia. Malaysia. PhD thesis.
- Ogada, T and Werther, J. (1996). Combustion characteristics of wet sludge in a fluidized bed. *Fuel*. 75. No. 5: 617 – 626.
- Patumsawad, S. and Cliffe, K.R. (2002). Experimental study on the fluidised bed combustion of high moisture municipal waste. *Energy Conversion and Management*. 43: 2329-2340.
- Pemberton, S.T. and Davidson, J.F. (1986). Elutriation From Fluidised Beds – I. Particle Ejection From The Dense Phase Into The Freeboard. *Chemical Engineering Science*. 41. No.2: 243-251.
- Perry's Chemical Engineers' Handbook (1997). Physical and Chemical Data. 2 – 186.
- Piao, G., Aono, S., Kondoh, M., Yamazaki, R. and Mori, S. (2000). Combustion test of refuse derived fuel in a fluidized bed. *Waste Management*. 20: 443 – 447.
- Pillai, K.K. (1981). The influence of coal type on devolatilisation and combustion in fluidized beds. *J. Inst. Energy*. 142-150.

- Pinto, F., Franco, C., Andre, R.N., Miranda, M., Gulyurtlu, I. and Cabrita, I. (2002). Co-gasification study of biomass mixed with plastic waste. *Fuel*. 81: 291-297.
- Qureshi, A.E. and Creasy, D.E. (1979). Fluidised Bed Gas Distributor. *Powder Technology*. 22: 113-119.
- Rajan, R.R. and Wen, C.Y. (1980). A Comprehensive Model for Fluidized Bed Coal Combustors. *AIChE Journal*. 26. No.4: 642-654.
- Rao, T.R. and Bheemarasetti, J.V.R. (2001). Minimum fluidization of mixtures of biomass and sands. *Energy*. 26: 633-644.
- Rietema, K. (1984). Powders, What Are They?. *Powder Technology*. 37: 5-23.
- Ross, D.P., Heidenreich, C.A., Zhang, D.K. (2000). Devolatilisation times of coal particles in a fluidized bed. *Fuel*. 79: 873-883.
- Rowe, P.N. (1976). Prediction of Bubble Size in a Gas Fluidized Bed. *Trans. Inst. Chem. Eng.* 54: 285.
- Rozainee, M. (1998). *Incineration of sludge waste in a novel rotating fluidized bed. University of Sheffield. United Kingdom. PhD thesis.*
- Rozainee, M. (2001). *Municipal solid waste characteristics in Kuala Lumpur. A report submitted to the Ministry of Housing and Local Government for designing of waste incinerator.*
- Ruth, L.A. (1998). Energy From Municipal Solid Waste: A Comparison with Coal Combustion Technology. *Prog. Energy Combust. Sci.* 24: 545-564.
- Saberi, Sh., Saberi, B., Shakourzadeh, K. and Guigon, P. (1995). Comparative study of tuyere designs for fluidised beds. *Chem. Eng. Journal*. 60: 75-79.
- Saenger, M., Hartge, E.U., Werther, J., Ogada, T. and Siagi, Z. (2001). Combustion of coffee husks. *Renewable Energy*. 23: 102-121.
- Salvador, S., Quintard, M. and David, C. (2004). Combustion of a substitution fuel made of cardboard and polyethylene: influence of the mix characteristics – experimental approach. *Fuel*. 83: 451-462.
- Sasongko, D., and Stubington, J.F. (1996). Significant factors affecting devolatilisation of fragmenting, non swelling coals in fluidized bed combustion. *Chemical Engineering Science*. 51. No. 16: 3909-3918.
- Sathiyamoorthy, D. and Rao, C.H.S. (1978). Gas Distributor in Fluidised Beds. *Powder Technology*. 20: 47-52.

- Saxena, S.C. and Jadav, S. (1983). A Two-Dimensional Gas Fluidized Bed For Hydrodynamic and Elutriation Studies. *Powder Technology*. 36: 61-70.
- Saxena, S.C., Chatterjee, A. and Patel, R.C. (1979). Effect of Distributors on Gas-Solid Fluidization. *Powder Technology*. 22: 191-198.
- Saxena, S.C., Wu, W.Y. and Fei, M.B. (1997). Fluidised Bed Combustion of Coal. *Energy*. 22. No. 11: 1029-1040.
- Scala, F. and Chirone, R. (2004). Fluidized bed combustion of alternative solid fuels. *Experimental Thermal and Fluid Science*. 28: 691 – 699.
- Stubington, J.F., Ng, K.W.K., Moss, B. and Peeler, P.K. (1996). Comparison of experimental methods for determining coal particle devolatilisation times under fluidized bed combustor conditions. *Fuel*. 98. 79. No.3: 233-240.
- Suksankraisorn, K., Patumsawad, S. and Fungtammasan, B. (2003). Combustion studies of high moisture content waste in a fluidized bed. *Waste Management*. 23: 433 – 439.
- Suksankraisorn, K., Patumsawad, S., Vallikul, P., Fungtammasan, B. and Accary, A. (2004). Co-combustion of municipal solid waste and Thai lignite in a fluidized bed. *Energy Conversion and Management*. 45: 947 – 962.
- Svoboda, K. and Hartman, M. (1981). *Ind. Eng. Chem. Process Des. Develop.* 20: 319.
- Swithenbank, J., Nasserzadeh, V., Goh, Y.R. and Siddal, R (1997). Fundamental Principles of Incinerator Design. *Proceedings of the 1st International Symposium on Incineration and Flue Gas Treatment Technology*. Sheffield. United Kingdom.
- Thipse, S.S., Sheng, C., Booty, M.R., Magee, R.S. and Bozzelli, J.W. (2002). Chemical makeup and physical characteristics of a synthetic fuel and methods of heat content evaluation for studies on MSW incineration. *Fuel*. 81: 211-217.
- Tillman, D.A. (1991). *The combustion of solid fuels and waste*. Academic Press. San Diego
- Turton, R and Clark, N.N. (1987). An Explicit Relationship to Predict Spherical Particle Terminal Velocity. *Powder Technology*. 53: 127-129.
- Upadhyay, S.N. and Saxena, S.C. (1981). Performance Characteristics of Multijet Tuyere Distributor Plates. *Powder Technology*. 30: 155-159.

- Wen, C.Y. and Yu, L.H. (1982). Fluidised Bed Freeboard Phenomena: Entrainment and Elutriation. *AIChE Journal*. 28. No.1.
- Wen, C.Y. and Yu, Y.H. (1966). Mechanics of fluidization. *Chemical Engineering Progress Symposium Series*. 62: 100 – 111.
- Wen, C.Y., Krishnan, R., Khosravi and Dutta, S. (1978). Dead Zone Heights Near the Grid of Fluidised Beds. Fluidization. *Proceedings of the Second Engineering Foundation Conference*. Cambridge University Press. 32 – 37.
- Werther, J. (1978). Influence of the Distributor Design on Bubble Characteristics in Large Diameter Gas Fluidised Beds. *Proceedings of the Second Engineering Foundation Conference*. Cambridge University Press. 7 – 12.
- Wu, S.Y. and Baeyens, J. (1991). Effect of Operating Temperature on Minimum Fluidization Velocity. *Powder Technology*. 67: 217-220.
- Yan, R., Liang, D.T., Laursen, K, Li, Y., Tsen, L. and Tay, J.H. (2003). Formation of bed agglomeration in a fluidised multi-waste incinerator. *Fuel*. 82: 843-851.
- Yang, Y.B., Goh, Y.R., Zakaria, R., Nasserzadeh, Swithenbank, J. (2002). Mathematical modeling of MSW incineration on a travelling bed. *Waste Management*. 22: 369-380.
- Yang, Y.B., Yamauchi, H., Nasserzadeh, V. and Swithenbank, J. (2003). Effect of fuel devolatilization on the combustion of wood chips and incineration of simulated municipal solid wastes in a packed bed. *Fuel*. 82: 2205-2221.
- Yates, J.G. (1983). *Fundamentals of Fluidized-bed Chemical Processes*. Butterworths. London.
- Yin, C., Rosendahl, L.A. and Kaer, S.K. (2008). Grate-firing of biomass for heat and power production. *Progress in Energy and Combustion Science*. 34: 725-754.
- Zakaria, R. (2000). *Static Incinerator Bed Combustion*. University of Sheffield, Chemical and Process Engineering Department. United Kingdom. PhD thesis.
- Zenz, F. and Othmer, D. (1960). *Fluidization and Fluid-Particle Systems*. J. Wiley & Sons. New York.