

INSULATION ASSESSMENT OF HIGH VOLTAGE OIL IMPREGNATED
PAPER BUSHING AND RESIN IMPREGNATED PAPER BUSHING

NURUL AZREENA BT KU AZIZAN

A project report submitted in partial fulfilment of the
requirements for the award of the degree of
Master of Engineering (Electrical Power)

School of Electrical Engineering
Faculty of Engineering
Universiti Teknologi Malaysia

DECEMBER 2018

DEDICATION

This project report is dedicated to my late father, mother and my twin sister.

ACKNOWLEDGEMENT

In preparing this project report, I was in contact with many people, researchers, academicians, and practitioners. They have contributed towards my understanding and thoughts. Foremost I would like to express my sincere appreciation to my supervisor, Dr. Mohd Hafizi bin Ahmad, for encouragement, guidance, critics and immense knowledge. His guidance helped me in all the time of research and writing the project report. Besides my advisor, I would like to thank all of my work colleagues for encouragement and supporting me throughout this year, and others who have provided assistance at various occasions along this journey. Their views and tips are useful indeed. Last but not least, I would like to wish my family and friends for their endless love and motivation. Without their continued support and interest, this project report would not have been the same as presented here. It always seems impossible until it's done.

ABSTRACT

Transformer diagnostic testing is performed to reveal the condition of the transformer. Early detection of problems can minimize the repairs involved and mitigate catastrophic failures. CIGRE findings show that bushings are a common reason for power transformer failures. There are few research developments conducted over the years to improve construction of condenser bushings. One of the first technologies was the Resin Bonded Paper (RBP), but not manufactured anymore due to many technical & environmental reasons. Secondly and the most widely used is Oil Impregnated Paper (OIP) technology apparently because of its low primary cost. In the circumstances, whenever there is a problem with the insulation or internal degradation, it can accumulate high internal pressure inside the bushing which can cause explosion of OIP bushing. That's why migration from Oil Type to Dry Type Bushing Technology was chosen to reduce the risk of explosion / caught in fire during bushing failures. The new safer alternative considered is the Resin Impregnated Paper (RIP) technology which offers better technical performance over OIP bushings. This study presents a comparison on insulation assessment of both types of bushing through power factor measurement and dielectric frequency response (DFR) analysis that contributes to the assessment of failure characteristics of OIP and RIP bushings. Field testing was implemented to capture data for comparison purposes focusing on selected power transformers in grid division installations. The measurement of bushing insulator capacitances and measurement of the dissipation factor is to determine bushing health conditions while DFR measurements are a supporting diagnostic tool for bushing condition assessment on paper inside the bushing. Commonly, both OIP & RIP constructions are that they are subject to very high mechanical, electrical and thermal stresses during operation. With the results of this study, it may become possible to identify failure characteristics of insulating material between Oil Impregnated Paper Bushings (OIP) and Resin Impregnated Paper Bushings (RIP) and explain that moisture content in oil and paper has significantly contributed to the degradation of bushing. This methodology can be utilized for an effective way to monitor moisture content at site and as a tool to decide the condition of insulation bushing.

ABSTRAK

Ujian diagnostik dilakukan untuk mengetahui keadaan penebat yang terdapat didalam alatubah kuasa. Pengesanan awal masalah dapat meminimumkan pembaikan yang terlibat dan mengurangkan berlakunya kegagalan yang teruk. Penemuan CIGRE menunjukkan bahawa bushings adalah punca utama bagi kegagalan alatubah kuasa. Terdapat beberapa perkembangan penyelidikan yang dilakukan selama bertahun-tahun untuk menambahbaik pembinaan *condenser bushing*. Salah satu teknologi pertama ialah *Resin Bonded Paper (RBP)*, tetapi tidak dihasilkan lagi disebabkan oleh isu pencemaran alam sekitar. Kedua yang paling banyak digunakan adalah teknologi *Oil Impregnated Paper (OIP)* kerana kos yang rendah. Tetapi apabila terdapat masalah dengan penuaan penebat disebabkan kelembapan dan pencemaran ia boleh mengumpul tekanan dalaman yang tinggi dan boleh menyebabkan letupan. Tambahan lagi dengan struktur luar *porcelain* akan menyebabkan keterukan yang melampau. Oleh itu penukaran penebat bushing dari jenis minyak ke arah teknologi jenis kering dipilih untuk mengurangkan risiko letupan ketika kegagalan berlaku. Alternatif yang lebih selamat ini dianggap dikenali sebagai teknologi *Resin Impregnated Paper (RIP)* yang menawarkan prestasi teknikal yang lebih baik daripada bushing jenis *Oil Impregnated Paper (OIP)*. Kajian ini memberi perbandingan kepada penilaian penebat kedua-dua jenis *bushing* ini melalui pengukuran faktor kuasa dan analisis tindak balas frekuensi dielektrik (DFR) yang menyumbang kepada penilaian kegagalan ciri-ciri OIP dan RIP bushings. Ujian lapangan dilaksanakan untuk mendapatkan data bagi tujuan perbandingan yang memberi tumpuan kepada alatubah kuasa amnya dan khusus kepada penebat bushing dan pengukuran *power factor* adalah untuk menentukan keadaan kesihatan *bushing* sementara pengukuran DFR sebagai alat diagnostik sokongan untuk penilaian keadaan kelembapan kertas yang terdapat didalam struktur *bushing*. Biasanya, kedua-dua pembinaan OIP & RIP adalah tertakluk kepada tekanan mekanikal, elektrik dan terma yang sangat tinggi semasa operasi. Dengan hasil kajian ini, dapat mengenal pasti ciri kegagalan bahan penebat antara OIP dan RIP. Dengan cara ini dapat menjadikan cara pengujian kelembapan *bushing* mudah dan secara efektif dapat menentukan keadaan penebat didalam *bushing*.

TABLE OF CONTENTS

	TITLE	PAGE
	DECLARATION	ii
	DEDICATION	iii
	ACKNOWLEDGEMENT	iv
	ABSTRACT	v
	ABSTRAK	vi
	TABLE OF CONTENTS	vii
	LIST OF TABLES	ix
	LIST OF FIGURES	x
	LIST OF ABBREVIATIONS	xi
	LIST OF APPENDICES	xii
CHAPTER 1	INTRODUCTION	1
1.1	Background	1
1.2	Problem Statement	4
1.3	Research Objectives	4
1.4	Scope of Work	5
1.5	Thesis Outline	5
CHAPTER 2	LITERATURE REVIEW	7
2.1	Concept and Measuring Technique in Insulation Model	7
2.1.1	Insulation Power Factor	7
2.1.2	Dielectric Response Measurement	10
2.2	Research Gap	10
CHAPTER 3	RESEARCH METHODOLOGY	13
3.1	Introduction	13

3.2	Testing Bushing Power Factor Test	15
CHAPTER 4	RESULT AND DISCUSSION	19
4.1	Results	19
4.1.1	Results from Field Test	19
4.2	Summary	24
CHAPTER 5	CONCLUSION AND RECOMMENDATIONS	26
5.1	Research Outcomes	26
5.2	Contributions to Knowledge	26
5.3	Future Works	26
REFERENCES		29
Appendices A-C		32-35

LIST OF TABLES

TABLE NO.	TITLE	PAGE
Table 2.1	IEC & IEEE limit for RIP & OIP	9
Table 4.1	Detail of power transformer	19
Table 4.2	Result bushing power factor and DIRANA testing	20

LIST OF FIGURES

FIGURE NO.	TITLE	PAGE
Figure 1.1	Description of graded condenser bushings	1
Figure 1.2	Power transformer HV and LV bushing	2
Figure 1.3	Power transformer bushing construction	3
Figure 2.1	Perfect dielectric	8
Figure 2.2	Measurement of dielectric	8
Figure 2.3	Dielectric Vector Group	9
Figure 3.1	Construction of outer and inside OIP and RIP bushing	13
Figure 3.2	Simple transformer bushing diagram	13
Figure 3.3	Project workflow	14
Figure 3.4	Set up C1 measurement & C2 measurement	15
Figure 3.5	Set up measurement for DIRANA testing	16
Figure 3.6	Dissipation factor/Tangent Delta over frequency range	17
Figure 4.1	Comparison for OIP bushing result	21
Figure 4.2	Comparison for OIP & RIP bushing result	21
Figure 4.3	Result DFR MTIN T2_OIP bushing	22
Figure 4.4	Result DFR JSIN T3_RIP bushing	23
Figure 4.5	Model curves of DIRANA	24
Figure 4.6	Findings on Bph bushing Trench COT failure	25

LIST OF ABBREVIATIONS

RBP	-	Resin Bonded Paper
OIP	-	Oil Impregnated Paper
RIP	-	Resin Impregnated Paper
RIS	-	Resin Impregnated Synthetics
DFR	-	Dielectric Frequency Response
PF	-	Power factor
R	-	Resistance
C	-	Capacitance
L	-	Inductance
HV	-	High voltage
TV	-	Tertiary voltage
LV	-	Low voltage

LIST OF APPENDICES

APPENDIX	TITLE	PAGE
Appendix A	Result Busing Power Factor & DIRANA Bushing HCOM T4	32
Appendix B	Result DIRANA Bushing JSIN T3	33
Appendix C	Result Busing Power Factor & DIRANA Bushing MTCP T1	35

CHAPTER 1

INTRODUCTION

1.1 Background

Power transformer bushing are use as insulated current pathway that connecting HV, LV, TV and Neutral windings terminals of a transformer. The purpose of the bushing is to keep the conductor insulated from the surface it is passing through [1,2]. Figure 1.1 shows description of graded condenser bushings that mostly high voltage bushings can be categorised in following three types based on their material, manufacturing & design:

- i. RBP (Resin Bonded Paper)
- ii. OIP (Oil Impregnated Paper) Bushing
- iii. RIP (Resin Impregnated Paper) Bushing.

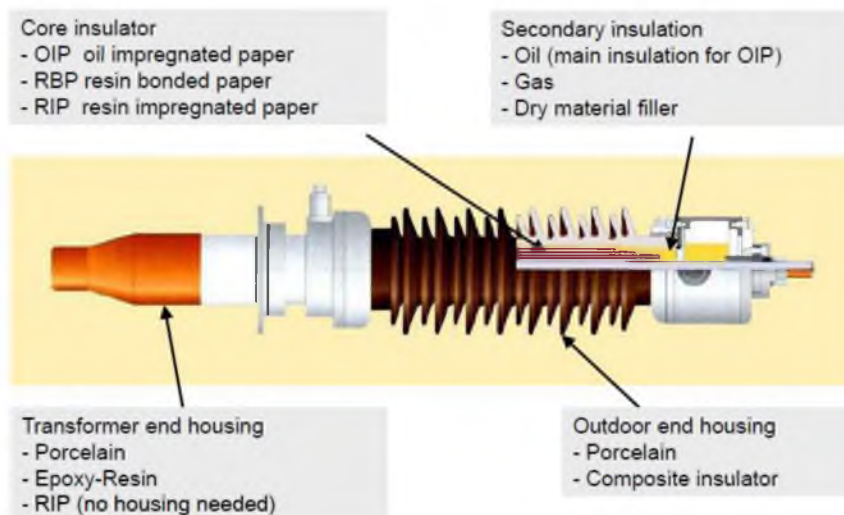


Figure 1.1 Description of graded condenser bushings

Inside of the bushing contain paper insulation and the bushing is often fill with oil to provide additional insulation. Common bushings failure mode due to partial discharge degradation in the insulation and cause a catastrophic failure to the power transformer.



Figure 1.2 Power transformer HV and LV bushing

Figure 1.2 shows power transformer HV & LV bushing installed. Different power utilities have adopted various methods monitoring to ensure the healthy condition of this power equipment. Solid insulation paper impregnated with transformer oil work as the chief insulation component in the condenser bushing. Hence ageing of pure (cellulose) paper becomes important aspect in judging the life of high voltage bushing [2]. Operating records show that about 90% of all preventable bushing failures are cause by moisture entering the bushing through leaky gaskets or other openings [3].The moisture can root to reduction of the dielectric strength and could be further lead to discharges or tracking which may bridge the insulation at over-voltage/transient stress during the event.

Measurement of capacitance and dissipation factor at rated frequency is relatively easy to conduct and inferences can be made of overall condition of the insulation. Insulation diagnostic tests of dissipation factor and capacitance are traditionally measure at power frequency (50/60 Hz) and mostly at 10 kV. However in recent developments, dielectric response methods using Polarization-Depolarization Current (PDC) and Frequency Dielectric Spectroscopy (FDS) has been established to evaluate the status of the insulation moisture and aging state of the Oil and Paper Insulation(OIP)[2,3,4]. The Dielectric Frequency Response (DFR)

Analysis is a measurement of the dielectric properties (i.e. capacitance and dissipation factor) as a function of frequency, while the standard dissipation factor test is only performed at 50 Hz. The very low frequencies contain information on moisture in the solid insulation, while the position of the slope in the mid-range frequencies indicates the conductivity of the liquid insulation. This curve is compared to model curves and the moisture content of the cellulose insulation is calculated.

Why RIP Bushing are required? Like other power utility in the world, mostly install of High Voltage bushing install in the system are OIP bushing. However, RIP bushing is one of the best solution available today to overcome almost all the bushing failure cause, increase the system reliability and human safety. Therefore, the urge to change from OIP to RIP bushing is slowly on going and been actively conduct research.

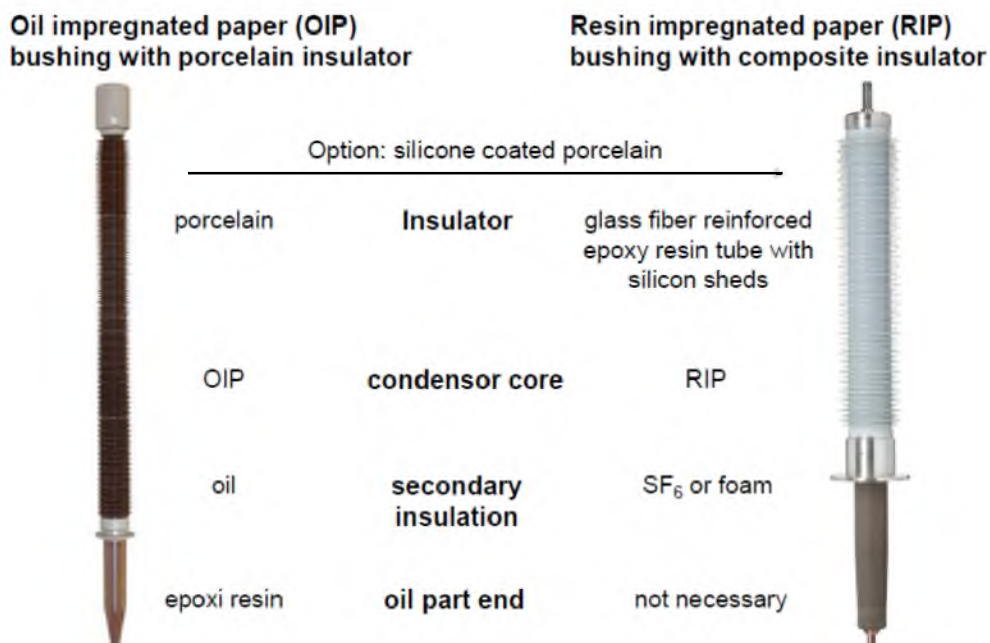


Figure 1.3 Power transformer bushing construction

Figure 1.3 shown comparison of bushing construction between OIP and RIP bushing. In order to reduce the OIP bushing failures and to overcome the disadvantages of OIP bushing, RIP bushing is one of most appreciated & latest solution available today.

1.2 Problem Statement

The major problem of OIP bushing is fire hazard and changes in power factor due to decrease in insulation resistivity caused by moisture ingress or external contamination. The reliability of transformer will be effected through unavailability to continue in service. Furthermore, explosions of transformer bushings have led to transformer failure and oil main tank spillage.

RIP bushing as compare to OIP based on its structure being an all-solid system, the oil phase is eliminated[11].Value of Tan Delta will not change significantly due to insulation degradation typically occurs over a very small area.Considered to be a safer alternative because the ability of self-extinguishing properties and no projection of dangerous broken pieces during a failure. Free maintenance cleaning of the insulator and hydrophobic - repel water rather than absorb also it can withstand temperatures up to 120 °C and better seismic withstand.

1.3 Research Objectives

The objectives of the research are:

- i. To conduct testing measurement on power factor & dielectric frequency response test for OIP & RIP bushings
- ii. To compare result on OIP & RIP bushings for insulation condition assessment.
- iii. To justify and improve decision to replace unhealthy bushing condition through result of moisture content in paper as DFR bushing testing is not a compulsory test during routine maintenance of transformer.
- iv. To identify failure characteristic of insulating material between OIP & RIP bushings.

1.4 Scope of Work

The scopes of this comparative study are to make sure development of the study is heading to the direction in fulfilling the objectives. There are several scopes to be follow:

- i. This study is focus on HV bushing of Power transformer installation in grid division
- ii. To conduct testing on power factor & dielectric frequency response for OIP & RIP bushing.
- iii. To find correlation of power factor & dielectric frequency response that contributing to failure characteristics of OIP vs. RIP Bushings

1.5 Thesis Outline

This thesis is dividing into five main chapters. Firstly, Chapter 1 is the introduction of the whole project including problem background, problem statement, objectives and scope of works. Chapter 2 will cover about concept and measuring technique in insulation model include insulation power factor and dielectric response measurement and other related topics. Data collection and analysis techniques will be discuss in Chapter 3. The analysis includes the comparison between both OIP and RIP Bushing measurement field-testing. Chapter 4 will contain data analysis results. The results obtained will be discussed and compare in term of OIP & RIP bushing failure characteristics, capacitances and insulation power factor. Finally, Chapter 5 will comprise project summarised and recommendations for further improvement and future studies.

REFERENCES

- [1] Tian Y, Zhuo R, Fu M, Dai Q, Qi B, Pan Q, Li C. The feasibility analysis of the comprehensive condition monitoring of insulation moisture defect of oil-impregnated paper bushing. In 2016 International Conference on Condition Monitoring and Diagnosis (CMD), 2016 Sep 25 (pp. 428-430). IEEE.
- [2] Bhutada S, Joshi S, Karandikar PB, Holmukhe RM. Insulation assessment of oil impregnated paper condenser bushings using dielectric frequency response technique. Indian Journal of Science and Technology. 2017 Jun 19;10(21).
- [3] Setayeshmehr A, Akbari A, Borsi H, Gockenbach E. On-line monitoring and diagnoses of power transformer bushings. IEEE Transactions on Dielectrics and Electrical Insulation. 2006 Jun;13(3):608-15.
- [4] Smith DJ, McMeekin SG, Stewart BG, Wallace PA. A dielectric frequency response model to evaluate the moisture content within an oil impregnated paper condenser bushing. IET Science, Measurement & Technology. 2013 Jul;7(4):223-31.
- [5] IEEE guide for application of power apparatus bushings. In IEEE Std C57.19.100-2012, 2013 Feb 22 (pp. I-71).
- [6] Sumereder C, Muhr M. Dielectric response measurements at high voltage bushings. In 2008 International Conference on Condition Monitoring and Diagnosis (CMD), 2008 Apr 21 (pp. 1150-1153). IEEE.
- [7] Keshwani S, Mataray M. RIP (Resin Impregnated Paper) bushing for EHV class power transformer. International Journal of P2P Network Trends and Technology. 2014 Mar;6:27.
- [8] Liu Z, Tu T, Euvrard E. Combining dry type Resin Impregnated Fiberglass paperless transformer bushings with built-in novel insulation monitoring function. In 2014 IEEE PES T&D Conference and Exposition, 2014 Apr 14 (pp. 1-5). IEEE.
- [9] Kanan, G, Egger, D. Field experience and reliability tests for the new Easy Dry condenser bushing. TechCon Asia/Pacific 2015.

- [10] Zhang JL, Yan J, Guo L. The case study of abnormal dielectric loss data of capacitive potential transformer bushings. *Shanxi Electric Power*. 2012;1:005.
- [11] Anglhuber, M, Krüger M. Dielectric analysis of high voltage power transformers. Klaus, Austria: Omicron Electronics; 2016
- [12] Jyothi NS, Ramu TS. A model for the temperature distribution in resin impregnated paper bushings. In 2012 Asia-Pacific Power and Energy Engineering Conference (APPEEC), 2012 Mar 27 (pp. 1-4). IEEE.
- [13] IEEE Std 62-1995. IEEE guide for diagnostic field testing of electric power apparatus-part 1: Oil filled power transformers, regulators, and reactors.
- [14] Mikulecky A, Stih Z. Influence of temperature, moisture content and ageing on oil impregnated paper bushings insulation. *IEEE Transactions on Dielectrics and Electrical Insulation*. 2013 Aug;20(4):1421-7.
- [15] Schuette, T, Czyżewski, J. Increasing transformer reliability by proactive management of the bushing fleet. Munich: INMR2015; 2015.
- [16] Li Z, Li W, Tang H, Jia P, Li J. A review on the insulating feature quantity of transformer bushing field testing technology and research status. In 2016 International Conference on Condition Monitoring and Diagnosis (CMD), 2016 Sep 25 (pp. 431-435). IEEE.
- [17] Qi B, Dai Q, Li C, Zeng Z, Fu M, Zhuo R. The mechanism and diagnosis of insulation deterioration caused by moisture ingress into oil-impregnated paper bushing. *Energies*. 2018 Jun;11(6):1496.
- [18] Asset Maintenance Department Transmission Division. Condition monitoring guideline. Malaysia: TNB 2014; 2014
- [19] Wang Y, Xiao K, Chen B, Li Y. Study of the impact of initial moisture content in oil impregnated insulation paper on thermal aging rate of condenser bushing. *Energies*. 2015 Dec 18;8(12):14298-310.
- [20] Nanda B, Reddy KS, Singh BP. Surge distribution in the Oil Impregnated Paper (OIP) bushing of 400KV transformer to determine failure initiated by draw lead. In 2015 Conference on Power, Control, Communication and Computational Technologies for Sustainable Growth (PCCCTSG), 2015 Dec 11 (pp. 48-52). IEEE.
- [21] Shayegani AA, Gockenbach E, Borsi H, Mohseni H. Investigation on the transformation of time domain spectroscopy data to frequency domain data

- for impregnated pressboard to reduce measurement time. *Electrical Engineering*. 2006 Oct 1;89(1):11-20.
- [22] Krüger M, Kraetge A, Koch M, Rethmeier K, Pütter M, Hulka L, Koch N, Muhr M, Summereder C. New diagnostic tools for high voltage bushings. In *International Conference on Condition Monitoring and Diagnosis*, 2010 Apr.
- [23] Subroto C. Modelling of dry lightning impulse test on 145 kV oil impregnated paper bushing for high voltage transformer. In *2016 3rd Conference on Power Engineering and Renewable Energy (ICPERE)*, 2016 Nov 29 (pp. 263-268). IEEE.
- [24] Przybyłek P, Moranda H, Walczak K, Moscicka-Grzesiak H. The bubble effect in bushings–investigations on models. *IEEE Transactions on Dielectrics and Electrical Insulation*. 2015 Dec;22(6):3405-12.